


# BASIC SPARK DETECTION SYSTEM DESIGN

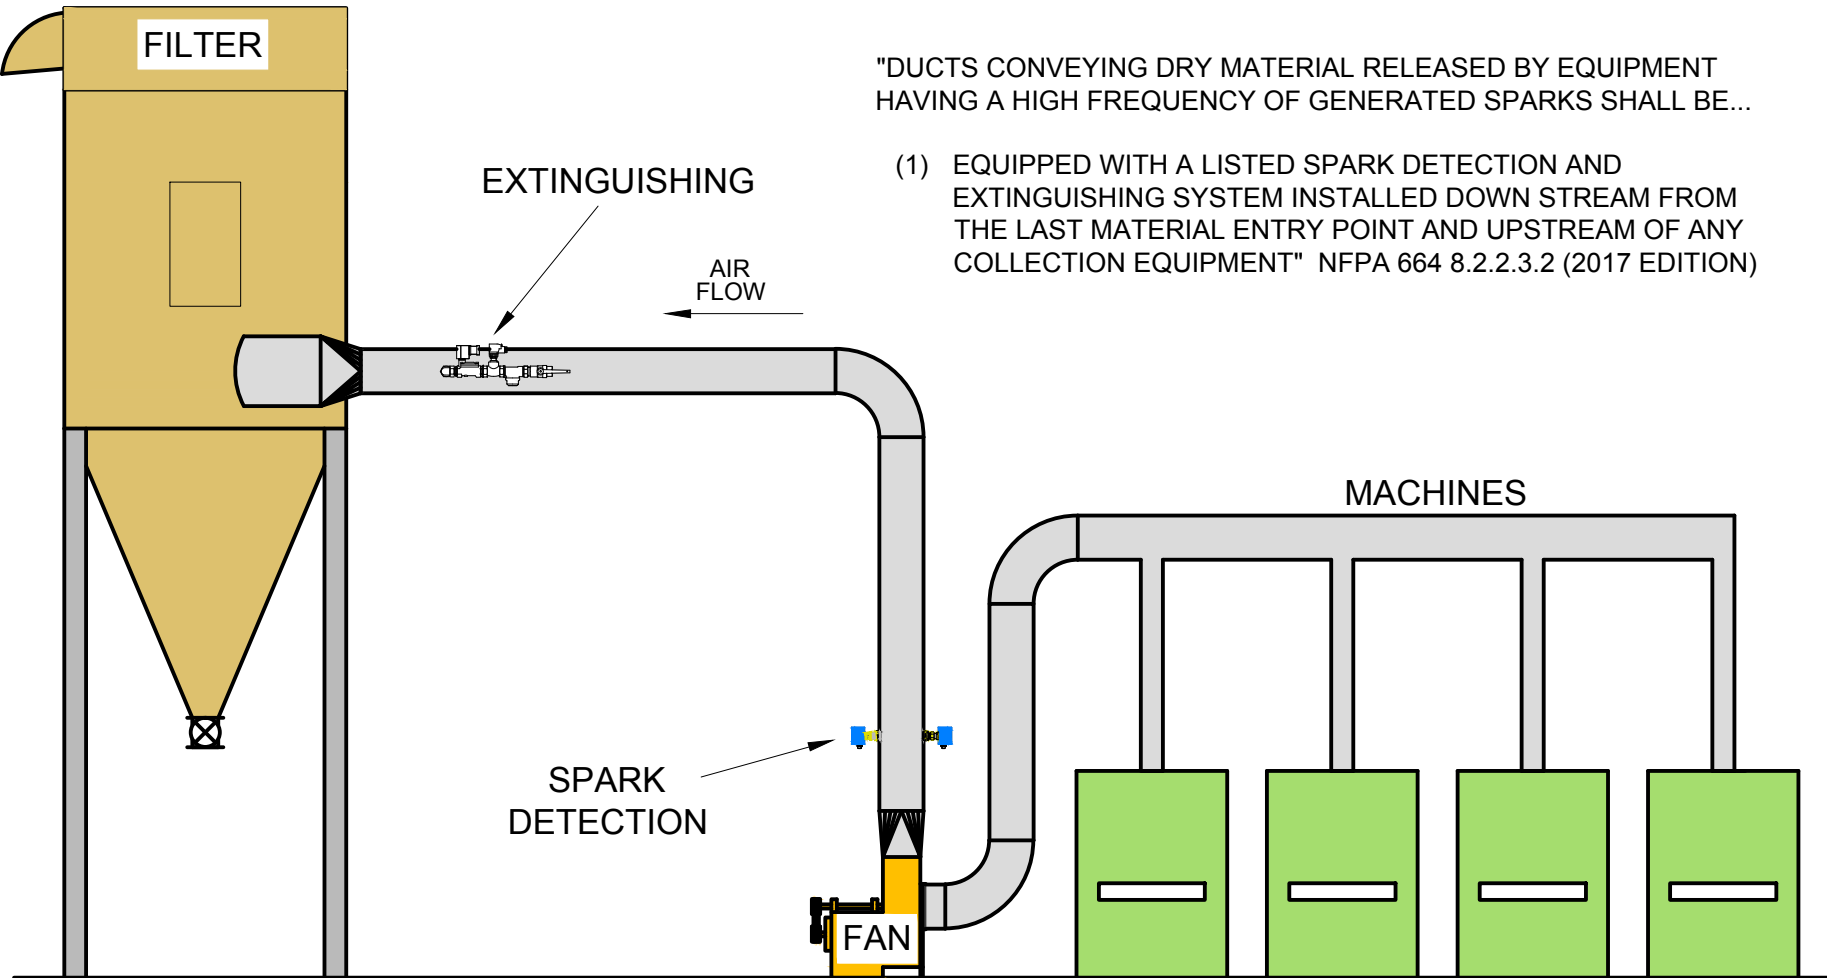

"DUCTS CONVEYING DRY MATERIAL RELEASED BY EQUIPMENT HAVING A HIGH FREQUENCY OF GENERATED SPARKS SHALL BE...

- (1) EQUIPPED WITH A LISTED SPARK DETECTION AND EXTINGUISHING SYSTEM INSTALLED DOWN STREAM FROM THE LAST MATERIAL ENTRY POINT AND UPSTREAM OF ANY COLLECTION EQUIPMENT" NFPA 664 8.2.2.3.2 (2017 EDITION)

 **FLAMEX<sup>®</sup> INC.**

4365 Federal Dr.  
Greensboro, NC 27407  
PH (336) 299-2933 FAX (336) 299-2944